


NOTE: SERVICE LINE FROM MAIN TO METER MUST BE TESTED UNDER STATIC PRESSURE AND INSPECTED BY THE AUTHORITY PRIOR TO BACKFILLING. ADDITIONALLY, IT IS HIGHLY RECOMMENDED THAT A TRACING WIRE BE INSTALLED ON PLASTIC SERVICES FROM THE METER PIT TO THE HOUSE.

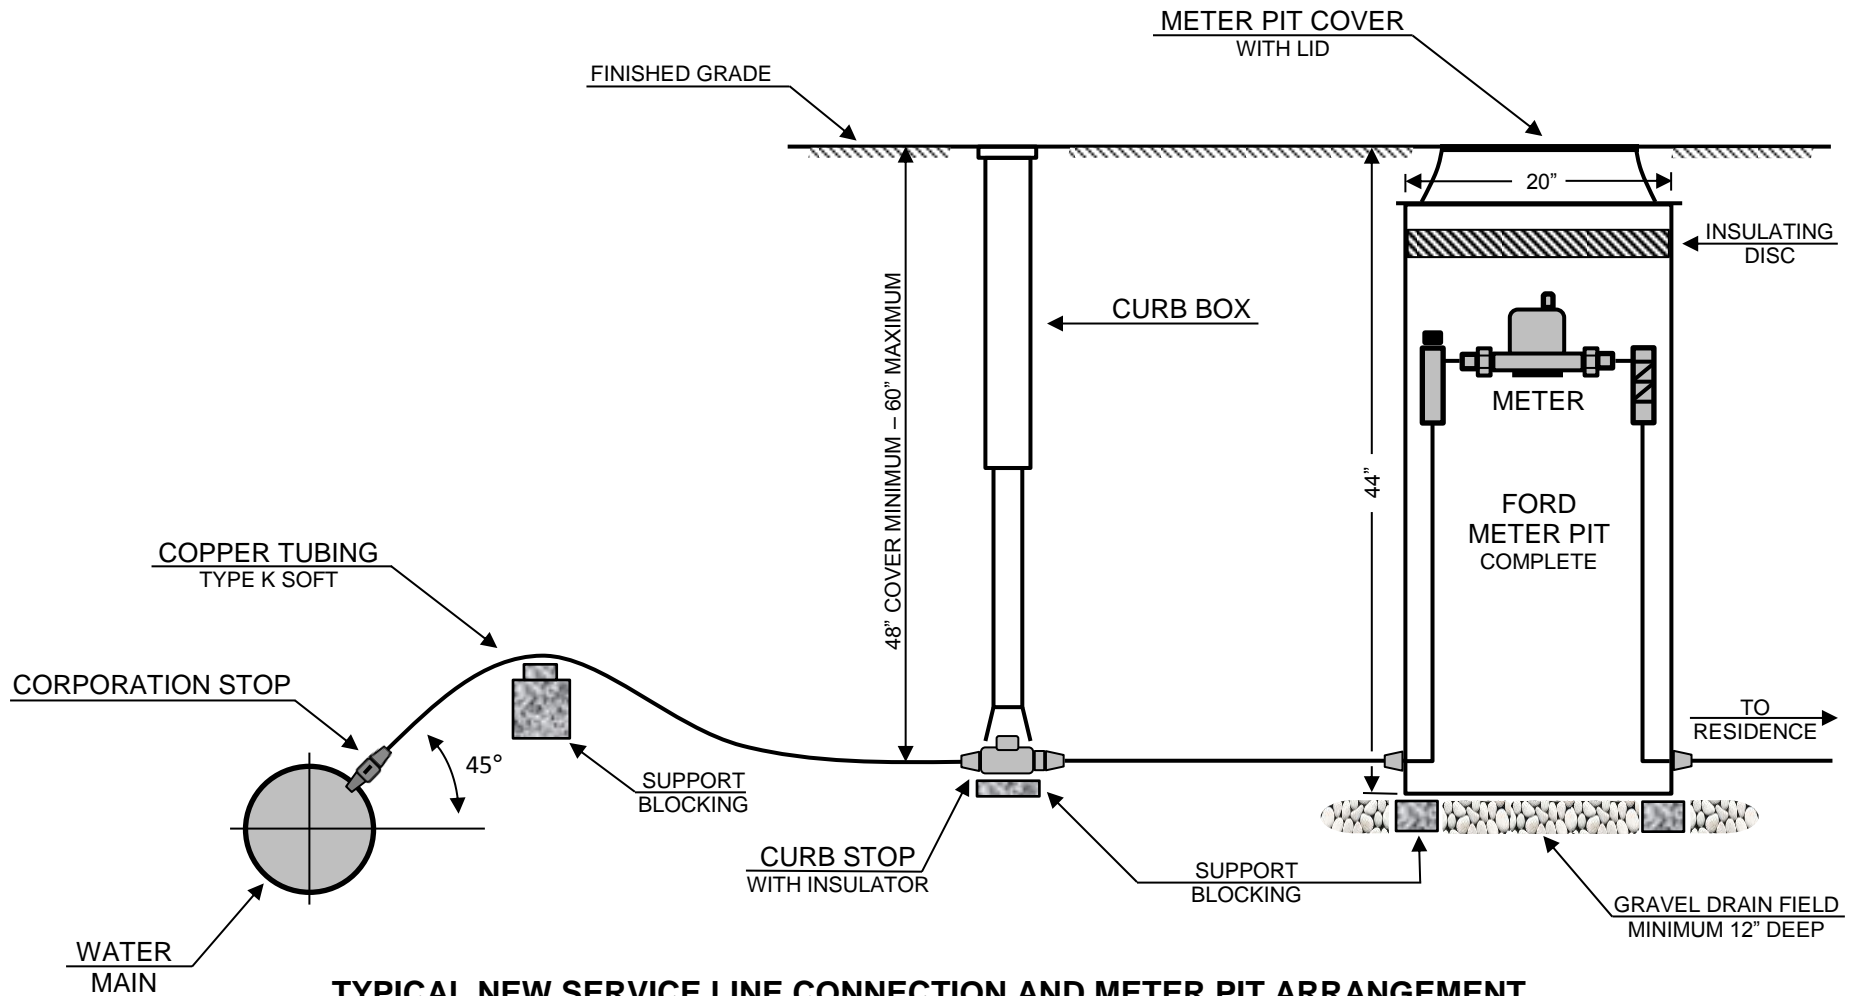

TYPICAL NEW SERVICE LINE CONNECTION AND METER PIT ARRANGEMENT